

FILTER PERFORMANCE CERTIFICATE

Clean&Science Co.,Ltd. (www.cands.co.kr)

#934,CHUNGUP 3rd Industrial Com.

Bukmyon, Chungup City Chollabuk Do, Korea

Tel 82-2-550-0900

Fax 82-63-536-7887



Head Office Tel 82-2-550-0800



Fax 82-2-551-0225

Filter:	RAF Filter	Frame	Nonwoven
Manufacturer:		Media	
LOT	RF001HYX	Separator	
Face Area:	0.16sqm	Filter Area:	207 x 188 x 15
Flowrate:	Efficiency(300CMH)	Status:	
		Comment:	Media Height : 13T, Pleat No. : 31P

Test Request	Optedetalkomplekt		
File name:	RAF Filter		
Date:	2016-12-08	Temperature	21°C
Time:	-	Tare Pressure:	-
Operator:	YJKIM	Test Aerosol	A2FINE
		Relative Humidity	61%r.F.

Differential Pressure Fractional Efficiency Test

Flowrate V [CMH]	Diff.Press dp(V) [Pa]	Particle size [μm]	Efficiency [%]
100	66	0.3~ 0.5	71.30%
200	141	0.5~1.0	86.00%
300	227	1.0~3.0	93.90%
400	316	3.0~5.0	97.40%
500	415	5.0~10.0	98.40%

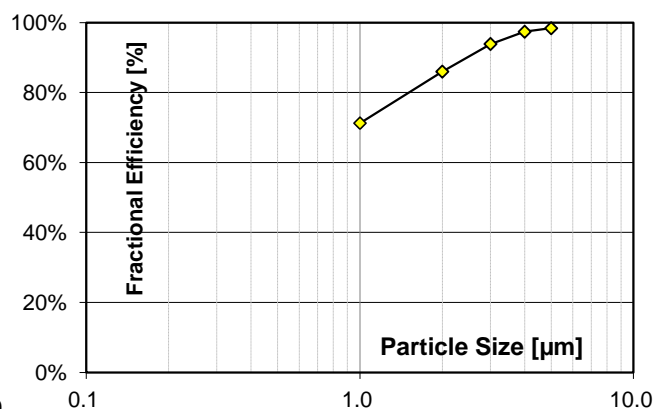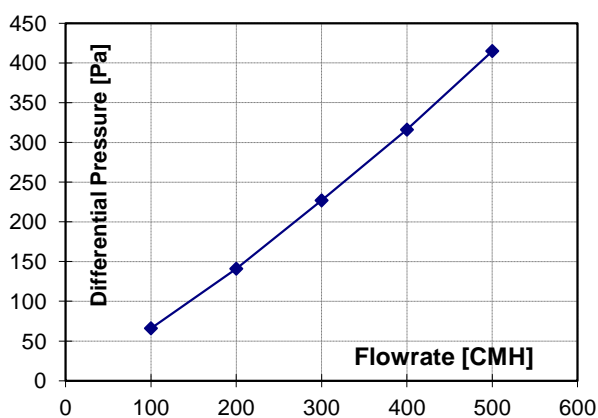

Dust Holding Capacity

Initial Pressure Drop	227
Final Pressure Drop	567
D.H.C	4.2g/EA